
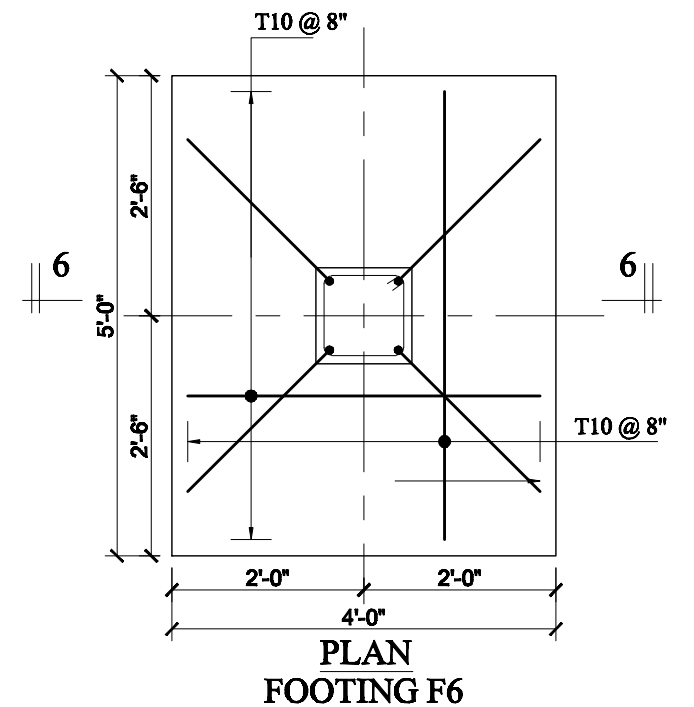
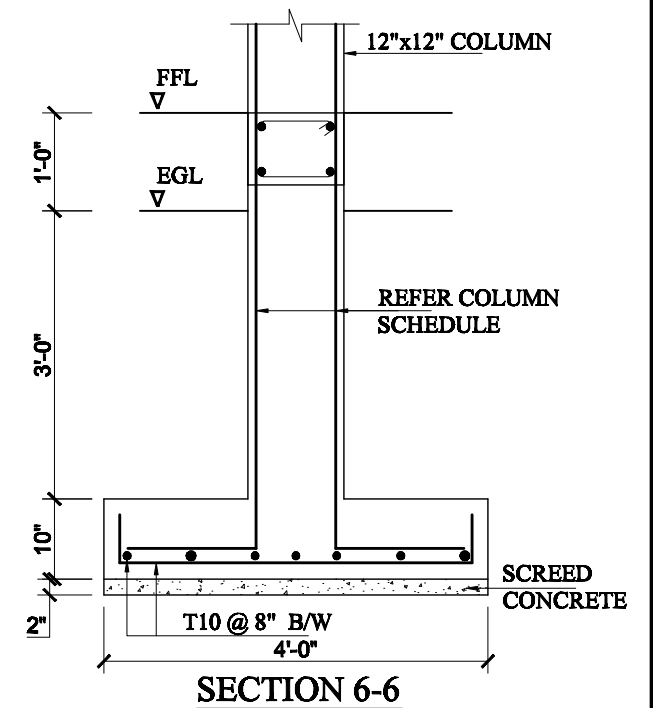
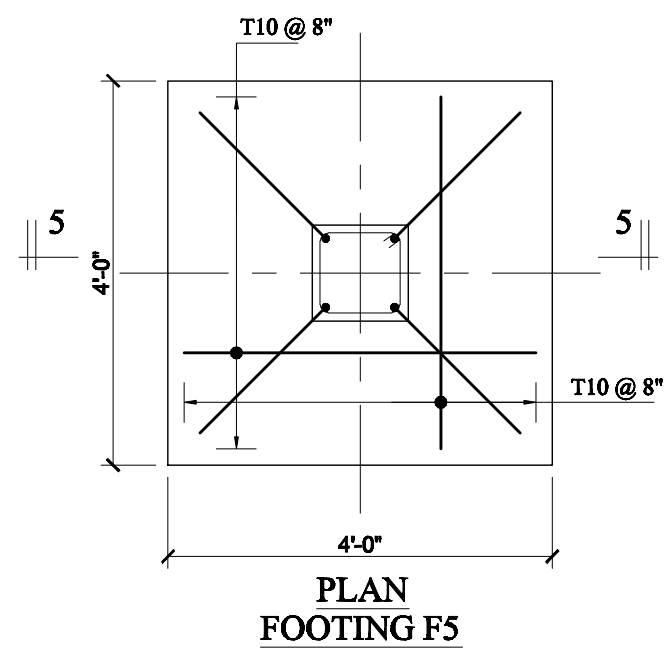
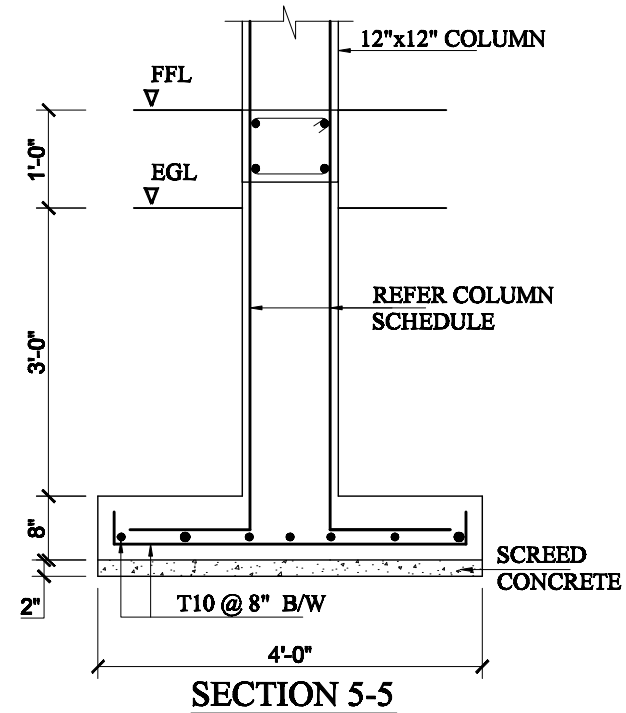
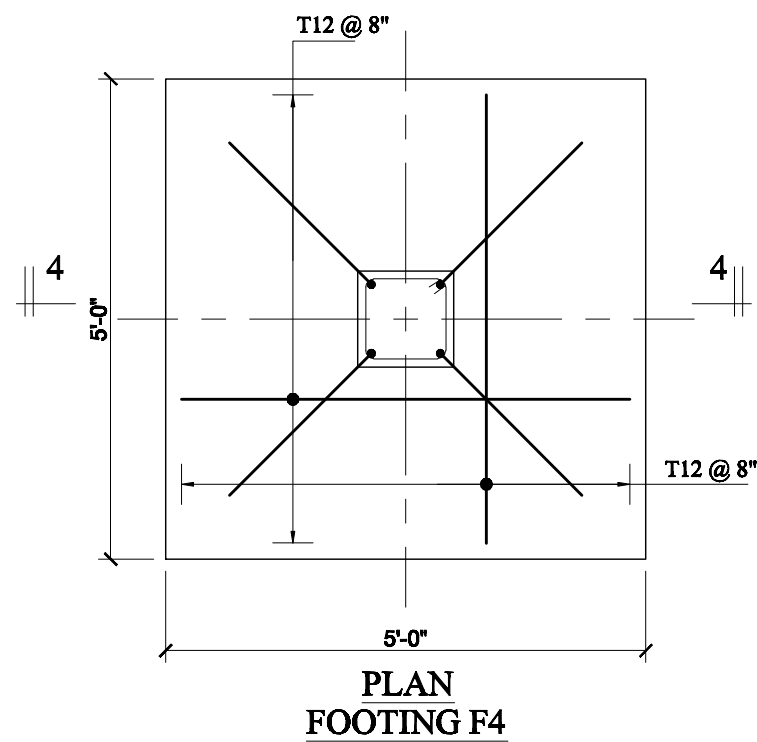
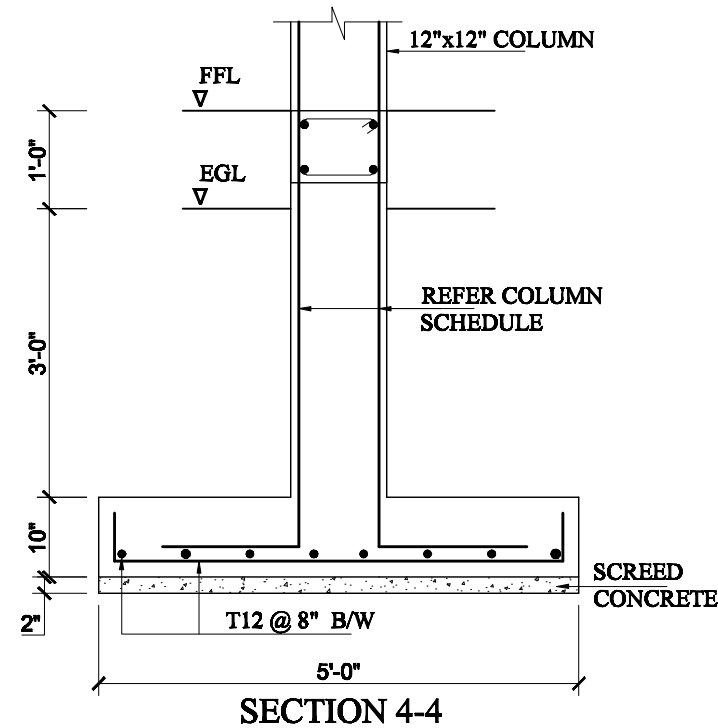
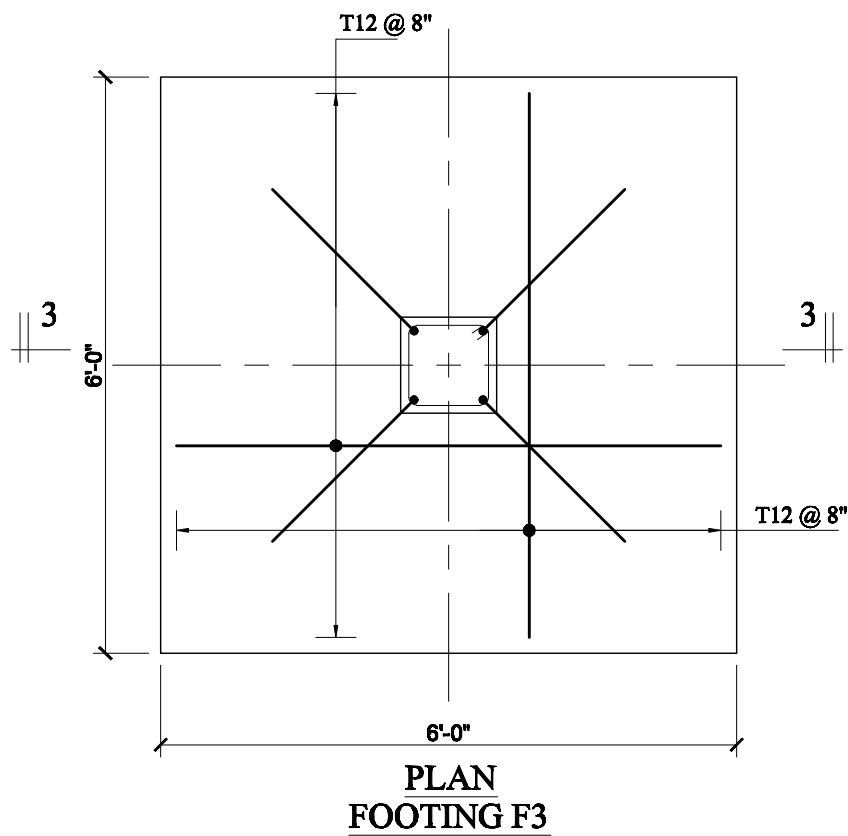


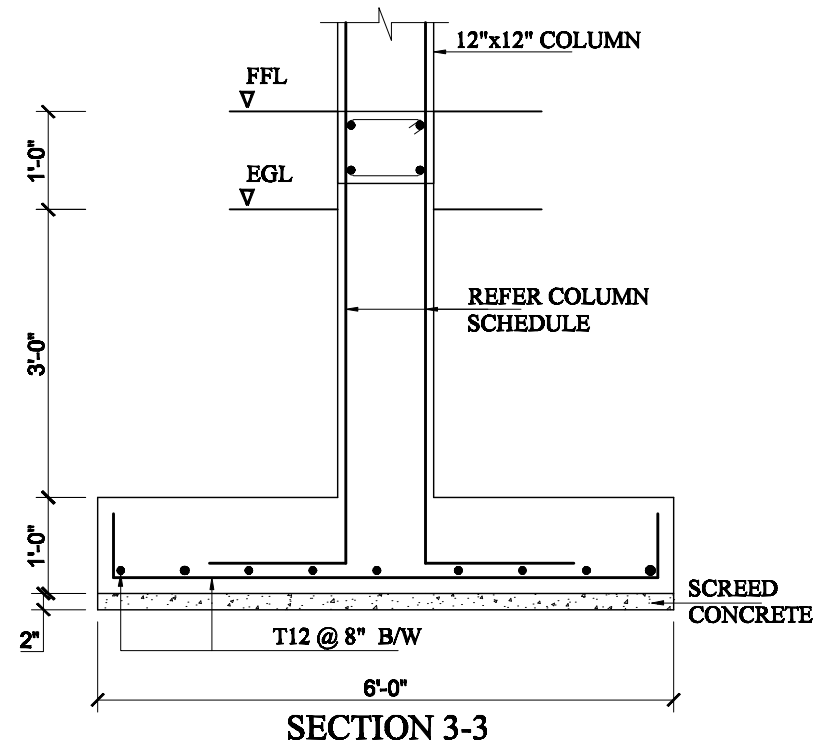

GENERAL NOTES :-

1. STRUCTURAL CONCRETE SHALL BE OF GRADE 25
2. NOMINAL COVER TO REINFORCEMENT SHALL BE 2" AGAINST EARTH, AND 1" ELSEWHERE
3. STEEL GRADE :-
T = 460 N / mm² TO BS 4449 OR THE EQUIVALENT
R = 250 N / mm² TO BE 4445 OR THE EQUIVALENT
4. MINIMUM LAP LENGTH TO BE 50 x SMALLEST BAR DIA
5. ALL DIMENSIONS TO BE CHECKED AND CONFIRMED WITH OTHER RELEVANT DRAWINGS BEFORE STARTING ANY CONSTRUCTION WORK
6. ASSUMED BEARING PRESSURE 120KN/mm²

SPECIAL NOTE

1. REFER ARCHITECTURAL DRAWING FOR THE LEVELS.